



Entrada y Salida de Alarma

Digital Output/Input 1

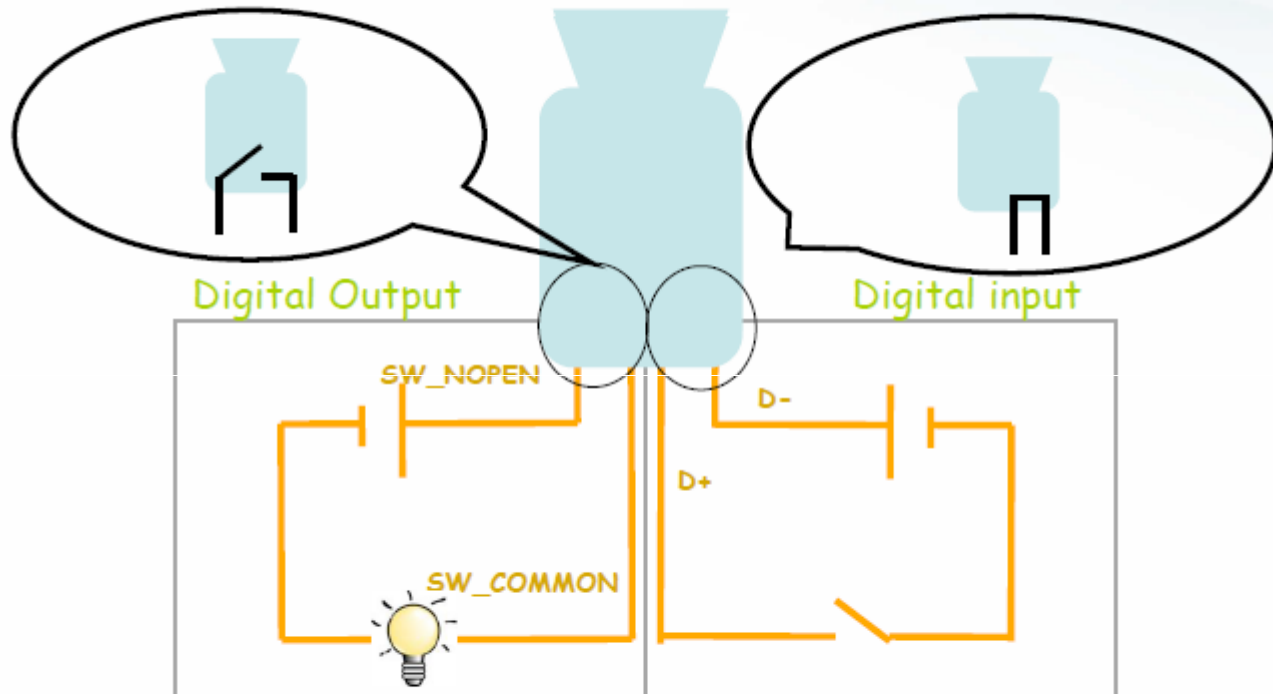

- 1 ← DI+ INPUT (Max. 50mA, 12VDC)
- 2 ← DI- INPUT
- 3 ← SW_COMMON OUTPUT (short with NC at initial state)
- 4 ← SW_NOPEN OUTPUT (Max. 1A, 24VDC or 0.5A, 125VAC)



1. Power
2. Digital output
3. Digital input
4. ground